FEOC

PUMPS

ANSI/ASME 2L PROCESS PUMP

SUPPLEMENT DRAWINGS ATTACHED WHEN LISTED BELOW	AVAILABLE FLANGES (ANSI B16.5)	OPTIONAL TAP CONNECTIONS
_____	CLASS 150 FF ☐ CLASS 150 RF ☐	
_____	CLASS 300 FF ☐ CLASS 300 RF ☐	
_____	SPECIAL _____ ☐	
_____	BASEPLATE	
_____	STEEL _____ ☐	
	SPECIAL _____ ☐	

TAP	REQ. SIZE	
I		CASING DRAIN
II		SUCTION NOZZLE CONN.
III		DISCHARGE NOZZLE CONN.
IV		AUXILIARY CONN.
V		STUFFING BOX
VI		BACK DRILLED SEAL FLUSH CONN.
VII		BOTTOM TAP IN STUFFING BOX

PUMP SIZE INLET X OUTLET - MAX. IMP. DIA.	PUMP WT LBS (KG)	CP	D	D5	D6	□	U SHAFT	U KEYWAY	X
2L 3 X 2 - 82	200 (91)	23 1/2 (597)	8 1/4 (210)	5 1/2 (140)	6 1/16 (154)	17 3/4 (451)	1 1/8 (29)	1/4 × 1/8 (6 × 3)	9 1/2 (241)

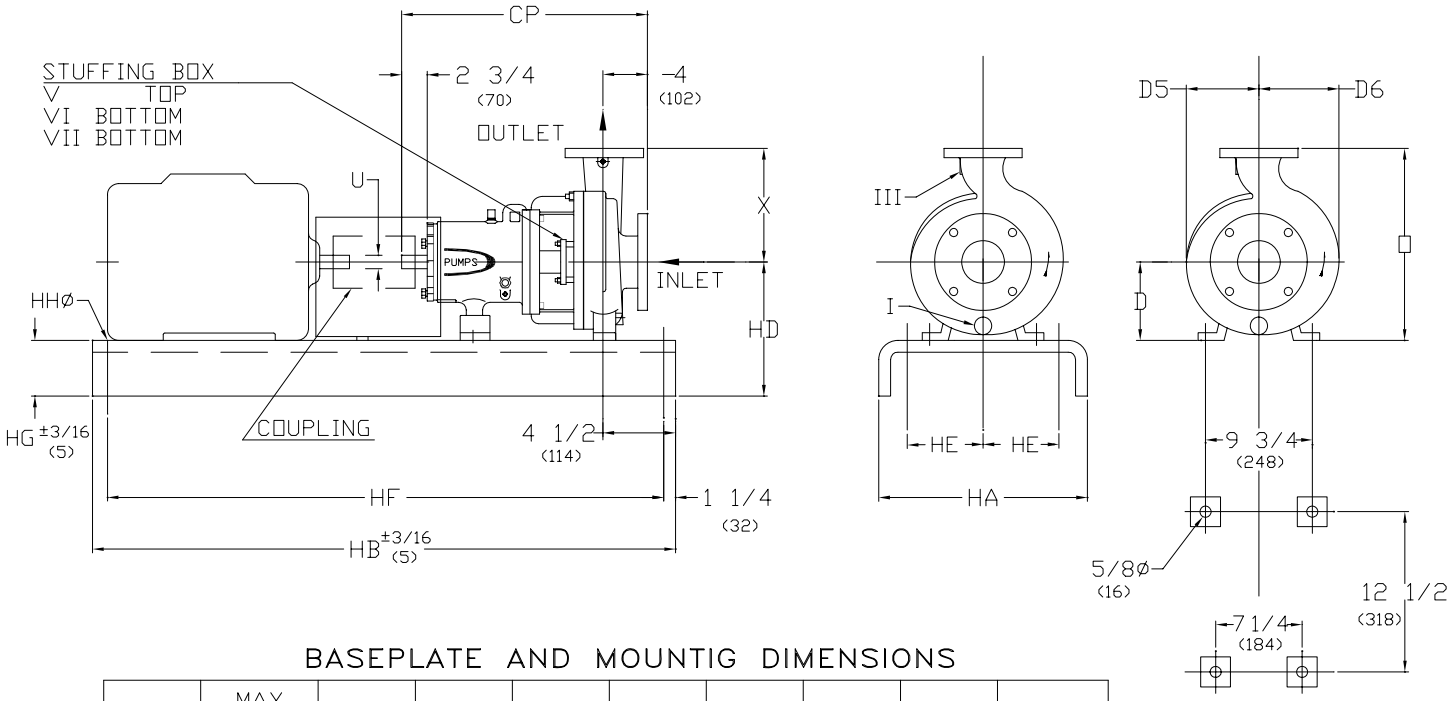

BARE PUMP MOUNTING DIMENSIONS

BASEPLATE AND MOUNTIG DIMENSIONS

	BASE	MAX MOTOR FRAME	HA	HB	HD	HE	HF	HG (NOTA 3)	HHØ	WEIGHT lbs (kg)
	245	184T	15 (381)	45 (1143)	12 (305)	4 1/2 (114)	42 1/2 (1080)	3 3/4 (95)	3/4 (19)	129 (59)
	252	215T	18 (457)	52 (1321)	12 3/8 (314)	6 (152)	49 1/2 (1257)	4 1/8 (105)	3/4 (19)	129 (80)
	258	286T	21 (533)	58 (1473)	13 (330)	7 1/2 (191)	55 1/2 (1410)	4 3/4 (121)	1 (25)	234 (106)
	264	326T	22 (559)	64 (1626)	13 (330)	7 1/2 (191)	61 1/2 (1562)	4 3/4 (121)	1 (25)	328 (149)
		365T			13 7/8 (352)					
	268	405TS	26 (660)	68 (1727)	14 7/8 (378)	9 1/2 (241)	65 1/2 (1664)	4 3/4 (121)	1 (25)	409 (186)
	280	449TS	26 (660)	80 (2032)	15 7/8 (403)	9 1/2 (241)	77 1/2 (1969)	4 3/4 (121)	1 (25)	481 (218)

1. DIMENSIONS IN PARENTHESIS () ARE IN MILLIMETERS
2. INSTALLATION DIMENSIONS ARE +- 1/8" (3) UNLESS OTHERWISE NOTED.
3. "HG" DIM. APPLIES TO THE LOWER PAD HEIGHT, WITH SOME BASES THIS WILL OCCUR AT PUMP END AND OTHERS AT MOTOR END.

CUSTOMER	CUSTOMER P.O.	CUSTOMER ITEM No.	
FEOC ORDER No.	SERIAL No.	CERTIFIED BY:	DATE